


高雄醫學大學第二教學研究大樓 285人國際會議廳 加長左右斜區之座椅垂直深度=100cm

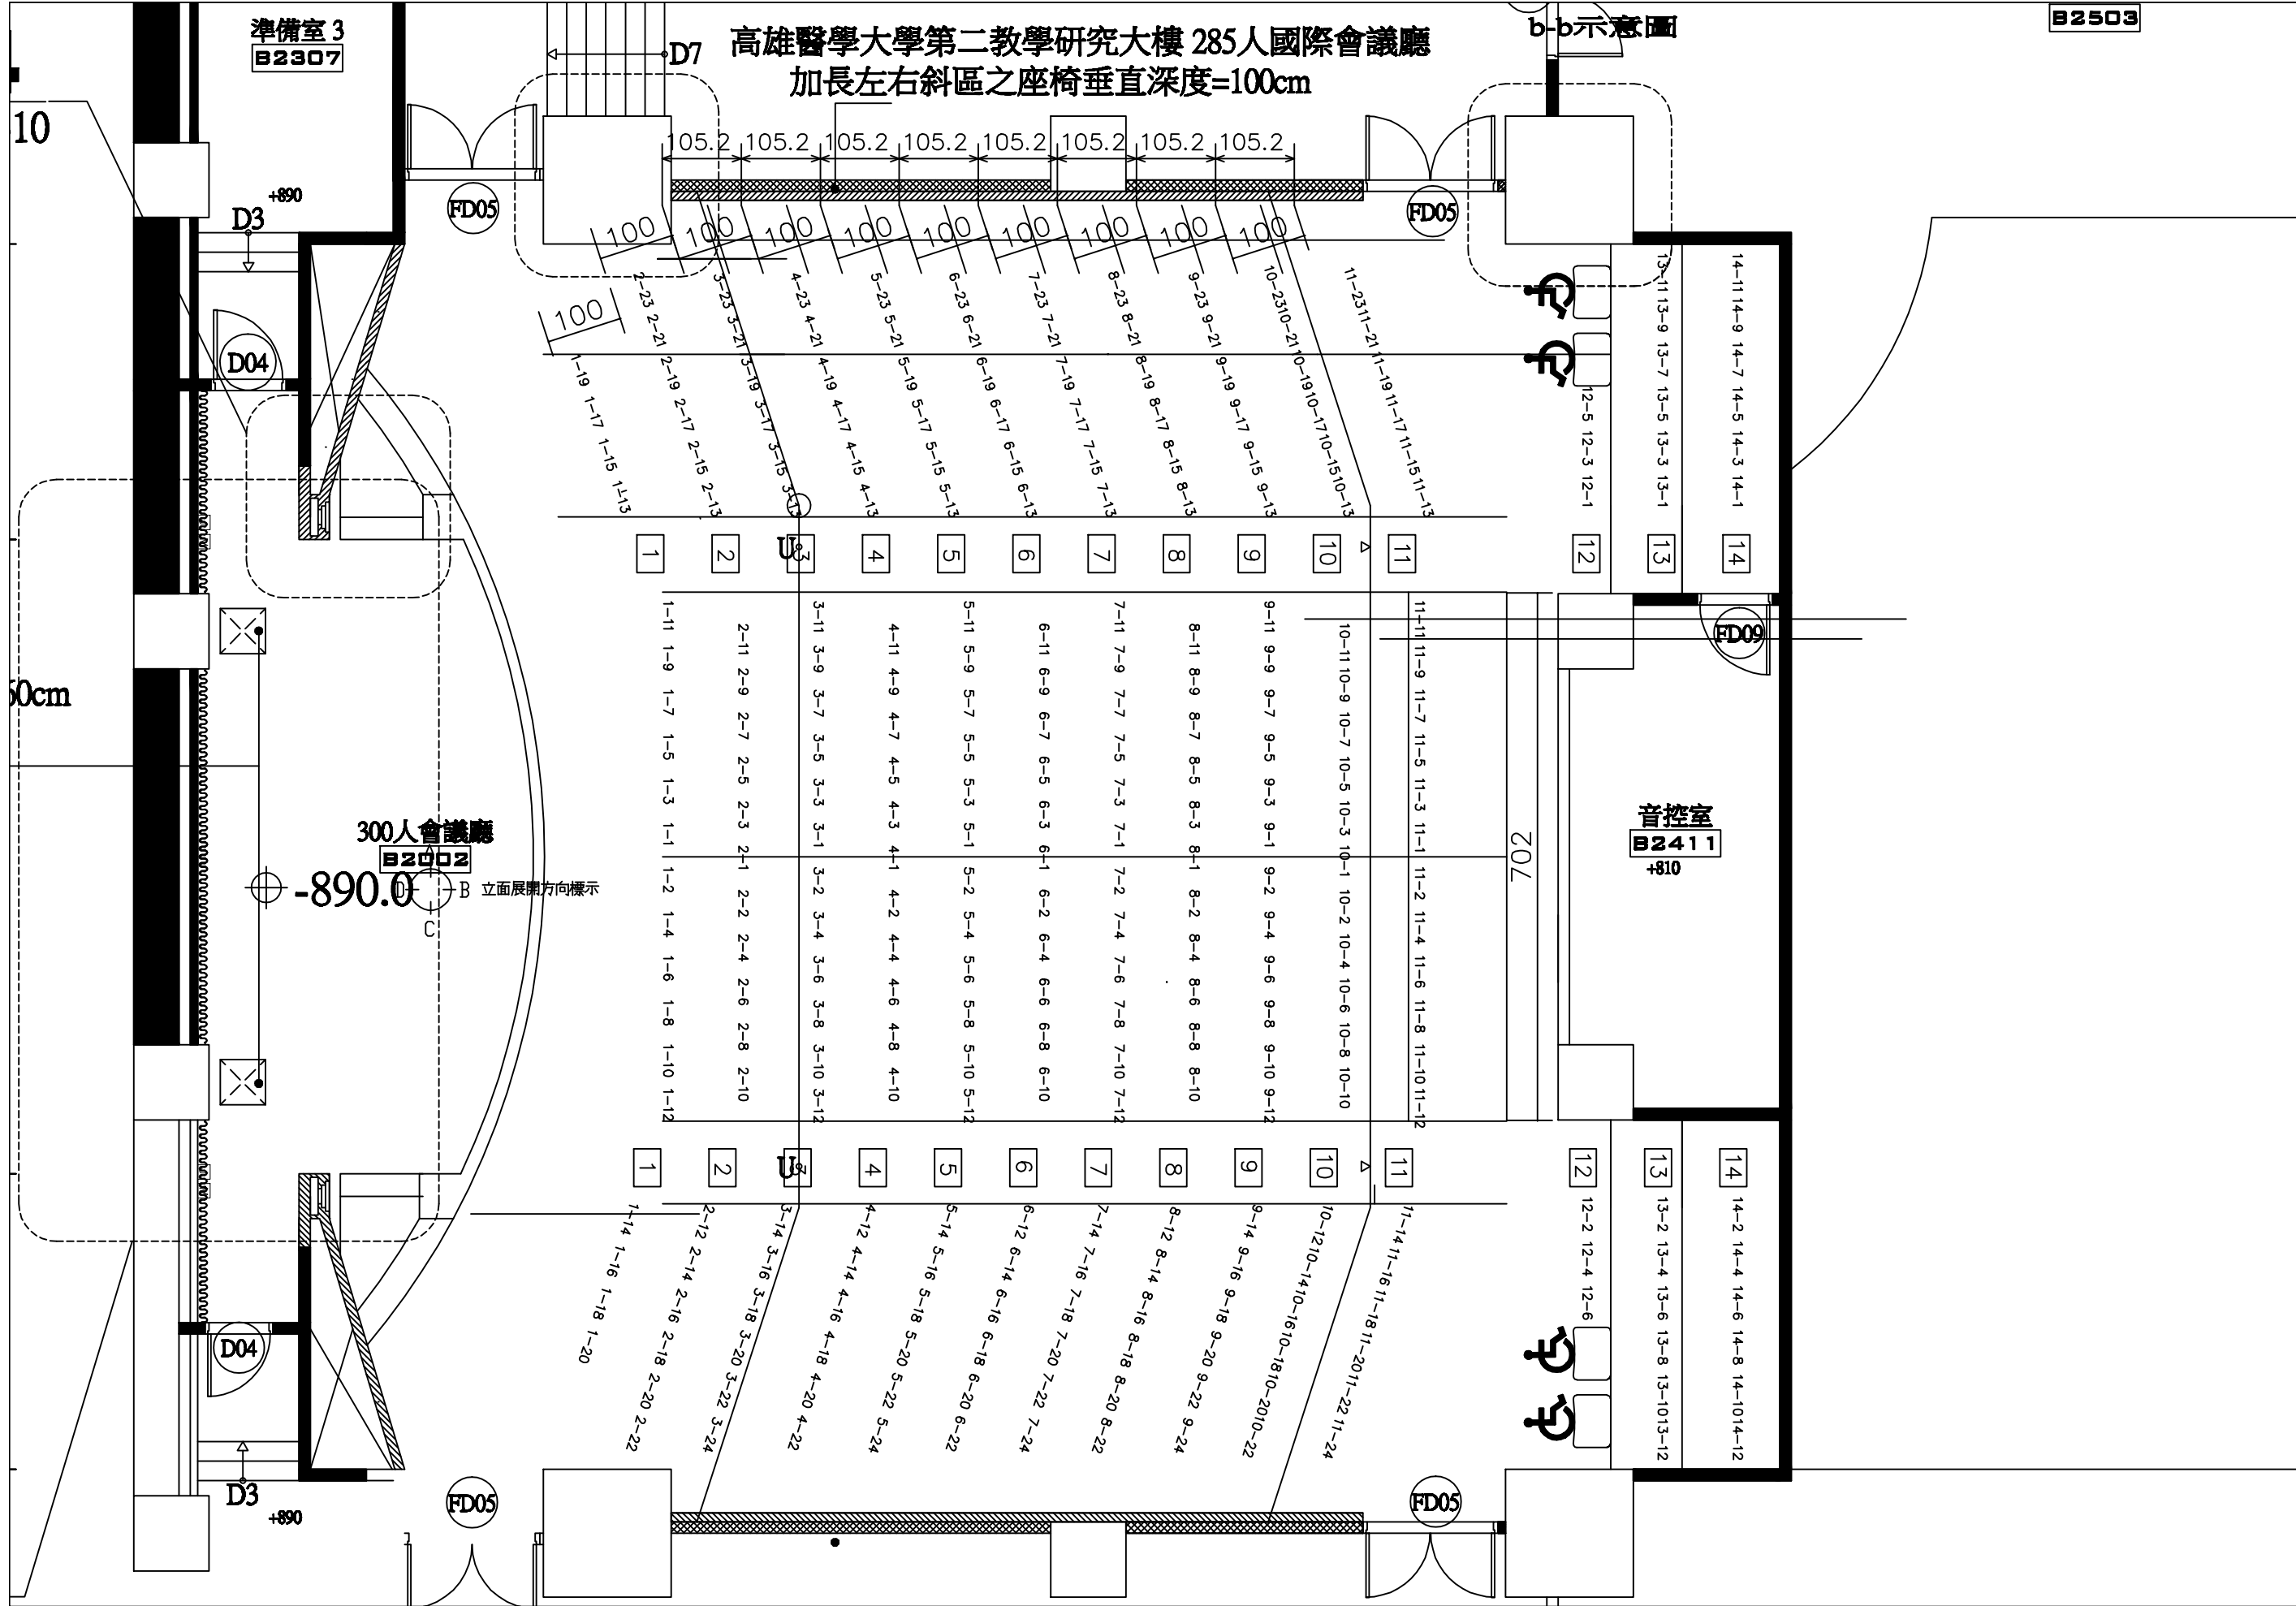

b-b示意圖

10

50cm

準備室 3
B2307

300人會議廳
B2002
-890.0

FD05

FD05

FD05

FD05

音控室
B2411
+810

FD09

D3 +890

D04

D04

D3 +890

B 立面展開方向標示

707

♿

♿

105.2 105.2 105.2 105.2 105.2 105.2 105.2

1-13 1-19 1-17 1-15 1-11 1-7 1-5 1-3 1-1 1-2 1-4 1-6 1-8 1-10 1-12
 2-13 2-19 2-17 2-15 2-11 2-7 2-5 2-3 2-1 2-2 2-4 2-6 2-8 2-10
 3-13 3-19 3-17 3-15 3-11 3-7 3-5 3-3 3-1 3-2 3-4 3-6 3-8 3-10 3-12
 4-13 4-19 4-17 4-15 4-11 4-7 4-5 4-3 4-1 4-2 4-4 4-6 4-8 4-10
 5-13 5-19 5-17 5-15 5-11 5-7 5-5 5-3 5-1 5-2 5-4 5-6 5-8 5-10 5-12
 6-13 6-19 6-17 6-15 6-11 6-7 6-5 6-3 6-1 6-2 6-4 6-6 6-8 6-10
 7-13 7-19 7-17 7-15 7-11 7-7 7-5 7-3 7-1 7-2 7-4 7-6 7-8 7-10 7-12
 8-13 8-19 8-17 8-15 8-11 8-7 8-5 8-3 8-1 8-2 8-4 8-6 8-8 8-10
 9-13 9-19 9-17 9-15 9-11 9-7 9-5 9-3 9-1 9-2 9-4 9-6 9-8 9-10 9-12
 10-13 10-19 10-17 10-15 10-11 10-7 10-5 10-3 10-1 10-2 10-4 10-6 10-8 10-10
 11-13 11-19 11-17 11-15 11-11 11-7 11-5 11-3 11-1 11-2 11-4 11-6 11-8 11-10 11-12
 12-13 12-19 12-17 12-15 12-11 12-7 12-5 12-3 12-1 12-2 12-4 12-6 12-8 12-10
 13-13 13-19 13-17 13-15 13-11 13-7 13-5 13-3 13-1 13-2 13-4 13-6 13-8 13-10 13-12
 14-13 14-19 14-17 14-15 14-11 14-7 14-5 14-3 14-1 14-2 14-4 14-6 14-8 14-10 14-12